


Location of Settling/Holding Tank and Pump out Point to be Drawn on Plan.

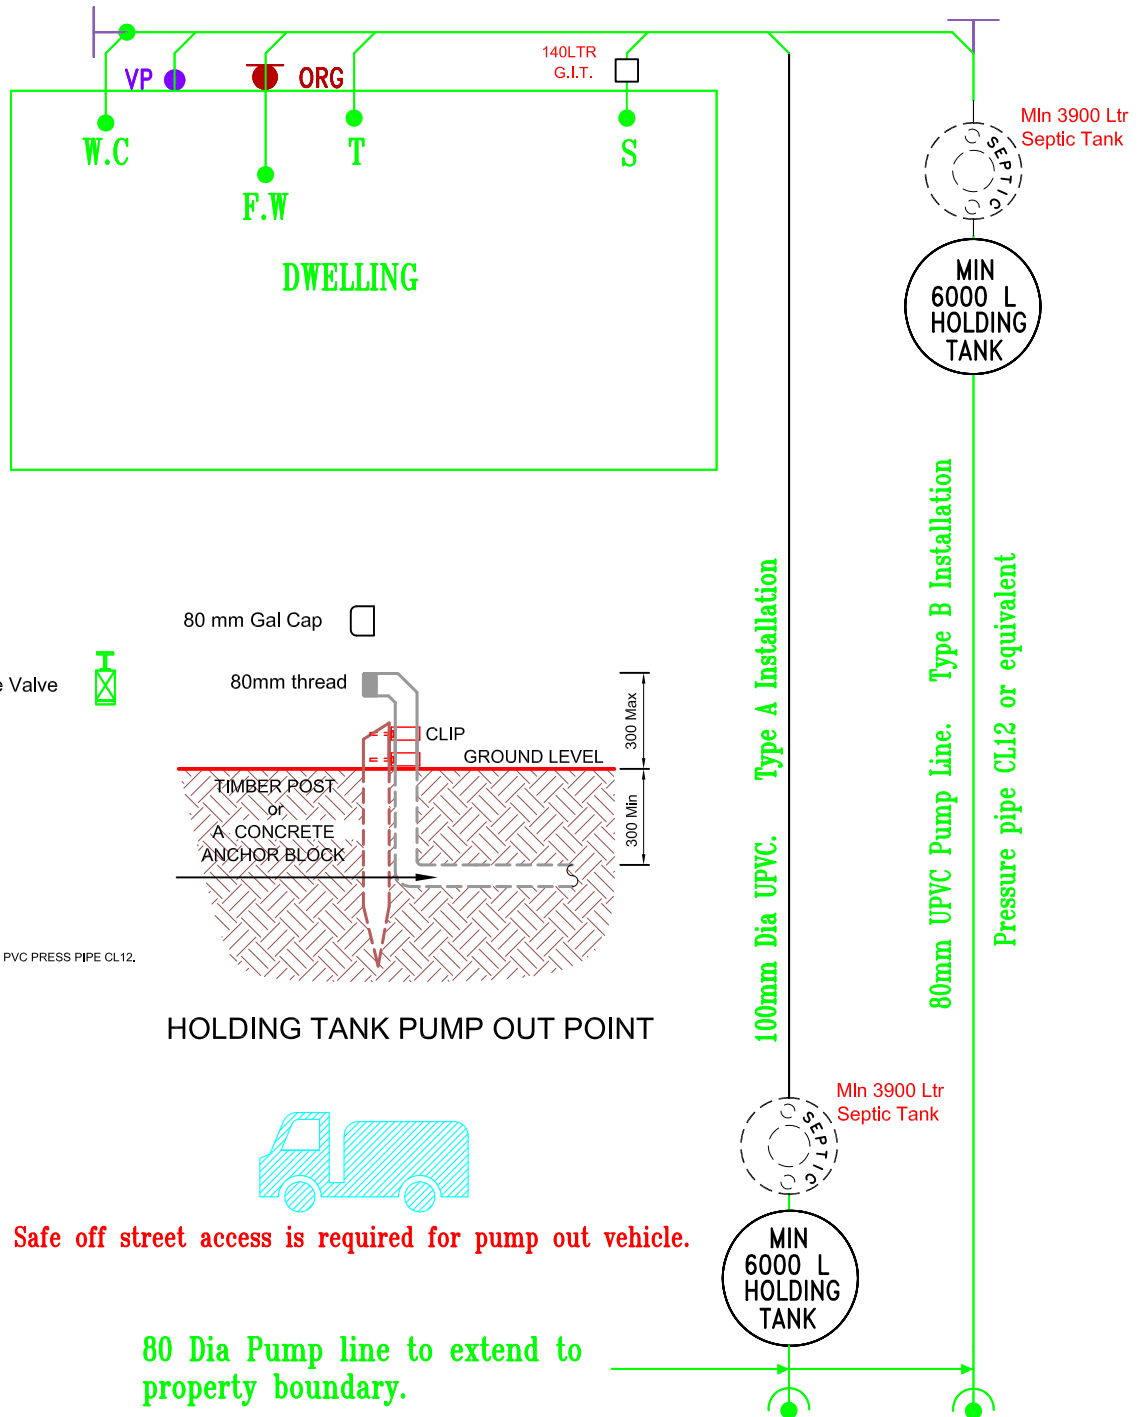

All holding tanks are to fitted with an audio and visual alarm system.
 All holding tank installations must be provided with an 80mm Dia pressure pump line extended to the property boundary. If point of discharge is lower than the holding tank, a gate valve must be installed. The maximum length of pump line shall not exceed 30m. The maximum vertical height allowable from the bottom of the holding tank to the pump-out point or road shall not exceed 5m. If these requirements can not be met a 3900l all-purpose septic tank and 450l pump well may be installed to pump uphill to the holding tank.
 The base of the holding tank shall be anchored with concrete to prevent lifting.

Pump-out point